

PARALLEL COMPUTING AIDED DESIGN OF EARTHING SYSTEMS FOR ELECTRICAL SUBSTATIONS IN NON HOMOGENEOUS SOIL MODELS

IGNASI COLOMINAS*, JAVIER GÓMEZ*, FERMÍN NAVARRINA*, MANUEL CASTELEIRO*
AND JOSÉ M. CELA†

Abstract. An accurate design of grounding systems is essential to assure the safety of the persons, to protect the equipment and to avoid interruptions in the power supply. In order to attain these targets, it is necessary to compute the equivalent electrical resistance of the system and the potential distribution on the earth surface in fault conditions. In this paper, a numerical approach for grounding analysis embedded in stratified soils and its implementation in a high-performance parallel computer are presented. The feasibility of this system is shown with its application to the grounding analysis in layered soils by using the geometry of real grounding grids.

Key words. Parallel computing, Grounding, Boundary elements, Numerical computations

1. Introduction. The interest for the prediction and the numerical simulation of problems related to the security have increased in last years with the construction of grounding systems of large electrical installations. The “grounding” or “earthing” systems comprises all interconnected grounding facilities of an specific area, being the “grounding grid” the main element of these systems. A grounding grid in most of real electrical substations consists of a mesh of interconnected cylindrical conductors, horizontally buried and supplemented by ground rods vertically thrust in specific places of the installation site.

The main objective of a grounding system is to provide means to carry and dissipate electrical currents into the ground, in order to guarantee the continuity of the power supply and the integrity of the equipment and to ensure that a person in the vicinity of the grounded installation is not exposed to a critical electrical shock. Thus, the apparent electrical resistance of the grounding system must be low enough to guarantee that fault currents dissipate mainly through the earthing electrode into the ground, while the values of electrical potentials between close points on earth surface that can be connected by a person must be kept under certain maximum safe limits (step, touch and mesh voltages)[1, 2].

Taking into account these previous aspects, it is obvious that the design of safe grounding systems in electrical installations is essential to assure the security of the persons, to protect the equipment and to avoid interruptions in the power service. Since the sixties, several methods and procedures for the analysis and design of grounding systems of electrical substations have been proposed, most of them based on practice, on semi-empirical works or on intuitive ideas. Although these techniques represented an important improvement in the grounding analysis area, some problems were reported such as large computational requirements, unrealistic results when segmentation of conductors was increased, and uncertainty in the error bounds[1, 3].

Since the early days of the industrial use of the electricity the problem of obtaining the potential distribution produced when a fault current is derived into the ground through an earthing grid has been a challenging one. Although the physical phenomena of fault currents dissipation into the earth is a well-known problem that can be modelled by means of Maxwell’s Electromagnetic Theory, its application and resolution for the computing of grounding grids of large installations in practical cases present some difficulties. First, it is obvious that no analytical solutions can be obtained in a real case. Moreover, the

*Applied Mathematics Dpt., Civil Engineering School, Universidad de A Coruña, Campus de Elviña, 15192 A Coruña, SPAIN (colominas@iccp.udc.es)

†Architecture of Computers Dpt., Universitat Politècnica Catalunya, Campus Nord-UPC mòdul D-6, Jordi Girona 1-3, 08034 Barcelona, SPAIN (cela@ac.upc.es)

specific geometry of the grounding systems (a mesh of interconnected bare conductors in which ratio diameter/length is relatively small) precludes the use of standard numerical techniques (such as the Finite Element Method or Finite Differences) since discretization of the domain (the whole ground) is required, and obtaining sufficiently accurate results should imply unacceptable computing efforts in memory storage and CPU time. For these reasons, during the last years the authors have developed a general numerical formulation based on the Boundary Element Method for the analysis of earthing systems embedded in uniform soil models, which has been successfully applied to real grounding grids[4, 5, 6]. At present, for real problems, single-layer models (“uniform models”) run in real-time in personal computers[7], while multiple-layer models break off the design process since the computing time is out of range.

Next, we present a generalization of the BEM formulation for the analysis of grounding systems embedded in stratified soils and the study of the parallelization of that code for its implementation in a high-performance parallel computer. Furthermore, we apply this approach to the analysis of a real grounding system in a layered soil model.

2. Mathematical Model of the Problem. Fault current dissipation into the ground through a grounding grid can be described by means of Maxwell’s Electromagnetic Theory. Thus, if one restricts the analysis to the electrokinetic steady-state response and neglects the inner resistivity of the earthing conductors (then, potential can be assumed constant in every point of the grounding electrode surface), the 3D problem can be written as

$$(2.1) \quad \begin{aligned} \operatorname{div}(\boldsymbol{\sigma}) &= 0, \quad \boldsymbol{\sigma} = -\boldsymbol{\gamma} \operatorname{grad}(V) \text{ in } E ; \\ \boldsymbol{\sigma}^t \mathbf{n}_E &= 0 \text{ in } \Gamma_E ; \quad V = V_\Gamma \text{ in } \Gamma ; \\ V &\rightarrow 0, \text{ if } |\mathbf{x}| \rightarrow \infty; \end{aligned}$$

where E is the earth, $\boldsymbol{\gamma}$ is its conductivity tensor, Γ_E is the earth surface, \mathbf{n}_E is its normal exterior unit field and Γ is the electrode surface [5, 6]. Therefore, when the earthing electrode is energized to a voltage V_Γ (Ground Potential Rise, or GPR) relative to a remote earth, the solution to problem (2.1) gives potential V and current density $\boldsymbol{\sigma}$ at an arbitrary point \mathbf{x} .

The current density vector field $\boldsymbol{\sigma}$ describes the stream of electric charges in the vicinity of each point. Thus, the scalar product $\boldsymbol{\sigma}^t(\mathbf{x})\mathbf{n}$ gives the electric charge flux, i.e. the amount of charge flowing per unit of surface and unit of time, in the direction of the vector \mathbf{n} at the point \mathbf{x} . In the steady state, by definition, the amount of charge does not vary at any point. Therefore, the equilibrium equation $\operatorname{div}(\boldsymbol{\sigma}) = 0$ in E is just a standard conservation law that expresses the indestructibility of charge. Obviously, this law can easily be derived from Maxwell’s equations [8, 9].

The constitutive equation $\boldsymbol{\sigma} = -\boldsymbol{\gamma} \operatorname{grad}(V)$ is a generalized version of Ohm’s law. In essence, Maxwell’s equations predict an ir-rotational electric field intensity $\boldsymbol{\mathcal{E}}$ for the steady state. Therefore, a so-called electric scalar potential V must exist, such that $\boldsymbol{\mathcal{E}} = -\operatorname{grad}(V)$ [8, 9]. Thus, the above constitutive equation establishes a linear relation between the current density $\boldsymbol{\sigma}$ and the electric field intensity $\boldsymbol{\mathcal{E}}$ at each point, in terms of the so-called conductivity tensor $\boldsymbol{\gamma}$. If the medium being dealt with is homogeneous, the conductivity tensor is constant. If the medium is isotropic, the conductivity tensor can be substituted by a scalar conductivity γ . Hence, in the case of a one-dimensional homogeneous and isotropic medium, the constitutive equation simply says that the current intensity per unit of surface is proportional to the loss of electric potential per unit of length, that is a known form of Ohm’s law.

Since the scalar product $\boldsymbol{\sigma}^t \mathbf{n}_E$ gives the electric charge flux in the direction of the normal to the earth surface, it must be clear now that the natural boundary condition $\boldsymbol{\sigma}^t \mathbf{n}_E = 0$ in Γ_E is equivalent to consider the air as a perfect insulator. On the other hand, the essential

boundary condition $V = V_\Gamma$ in Γ comes from neglecting the resistivity of the earthing electrode.

On the other hand, the essential boundary condition $V \rightarrow 0$ if $|\mathbf{x}| \rightarrow \infty$ assigns a null (arbitrary but convenient) value to the reference potential at remote earth [9]. Additionally, the potential V must satisfy some theoretical regularity requirements at infinity, the so-called “normal conditions” [9, 10, 11].

Now, for known values of V on Γ_E and $\boldsymbol{\sigma}$ on Γ , it is straightforward to obtain the design and safety parameters of the grounding system[1, 2]. Thus, the leakage current density $\sigma(\xi)$ at an arbitrary point ξ on the earthing electrode surface, the ground current I_Γ (total surge current being leaked into the earth) and the equivalent resistance of the earthing system R_{eq} , can be written as

$$(2.2) \quad \sigma(\boldsymbol{\xi}) = \boldsymbol{\sigma}^t(\boldsymbol{\xi})\mathbf{n}, \quad I_\Gamma = \int_{\boldsymbol{\xi} \in \Gamma} \sigma(\boldsymbol{\xi})d\Gamma, \quad R_{eq} = \frac{V_\Gamma}{I_\Gamma},$$

being \mathbf{n} the normal exterior unit field to Γ . Since V and $\bar{\sigma}$ are proportional to the GPR, the assumption $V_\Gamma = 1$ is not restrictive at all and it will be used from now on.

Most of the methods proposed for grounding analysis are based on the hypothesis that soil can be considered homogeneous and isotropic, and thus $\boldsymbol{\gamma}$ is substituted by an apparent scalar conductivity γ that must be experimentally obtained[1]. It is obvious that this assumption does not introduce significant errors if the soil is essentially uniform (both in horizontal and vertical directions) in the surroundings of the grounding grid[1], and this model can be used with loss of accuracy if the soil resistivity changes slightly with depth. However, since parameters involved in the grounding design can significantly vary if soil electrical properties change through the substation site (e.g., changes of the material nature, changes of humidity), it seems advisable to develop advanced models that could take into account variations of soil conductivity in the surroundings of the installation.

It is clear that to take into account the real variation of the soil conductivity in the vicinity of a grounding site would never be affordable, neither from the economical nor from the technical point of view. Hence, a more practical proposed soil model (and still quite realistic when conductivity is not markedly uniform with depth) consists of considering the soil stratified in a number of horizontal layers, defined by an appropriate thickness and an apparent scalar conductivity that must be experimentally obtained. In fact, it is widely accepted that two-layer (or even three-layer) soil models should be sufficient to obtain good and safe designs of grounding systems in most practical cases[1]. This chapter is devoted to studying the application of high performance computing techniques to two-layer soil models by means of parallelization, and its final implementation.

Consequently, if the soil is formed by C horizontal layers with different conductivities and the grounding electrode is buried in the layer b , the mathematical problem (2.1) can be written in terms of the following Neumann exterior problem[12, 13, 14]

$$(2.3) \quad \begin{aligned} \operatorname{div}(\boldsymbol{\sigma}_c) &= 0, \quad \boldsymbol{\sigma}_c = -\gamma_c \mathbf{grad}(V_c) \text{ in } E_c, \quad 1 \leq c \leq C; \\ \boldsymbol{\sigma}_1^t \mathbf{n}_E &= 0 \text{ in } \Gamma_E, \quad V_b = 1 \text{ in } \Gamma; \\ V_c \rightarrow 0 \text{ if } |\mathbf{x}| \rightarrow \infty, \quad \boldsymbol{\sigma}_c^t \mathbf{n}_c &= \boldsymbol{\sigma}_{c+1}^t \mathbf{n}_c \text{ in } \Gamma_c, \\ &1 \leq c \leq C - 1; \end{aligned}$$

being E_c each one of the soil layers, γ_c the scalar conductivity of layer E_c , V_c the potential at an arbitrary point of layer E_c and $\boldsymbol{\sigma}_c$ the corresponding current density, Γ_c the interface between layers E_c and E_{c+1} and \mathbf{n}_c the normal field to Γ_c [12, 14].

3. Variational Form of the Boundary Value Problem. As we have exposed, the real geometry of grounding systems in most of real electrical substations consists of a grid of

interconnected bare cylindrical conductors, horizontally buried and supplemented by rods, so ratio diameter/length uses to be relatively small ($\sim 10^{-3}$).

Although this geometry is straightforward to describe, it implies serious difficulties to the modellization of the problem: it is obvious that no analytical solutions can be obtained in a real case, and the use of standard numerical techniques (FEM or FD) should involve a completely out of range computing effort since discretization of the domain (the 3D domains E_c) is required. Consequently, and taking into account that potential values are only required on the earth surface and the equivalent resistance can be easily obtained in terms of the leakage current density σ on Γ ($\sigma = \boldsymbol{\sigma}^t \mathbf{n}$, where \mathbf{n} is the normal exterior unit field to Γ), we turn our attention to a Boundary Element approach which would only require the discretization of the grounding surface Γ [5, 6]. For this, it is first necessary to derive an expression to relate the potential V and the leakage current density σ .

Since the surroundings of the substation site are levelled and regularized during the construction of the electrical installation, earth surface Γ_E and interfaces Γ_c between layers can be assumed horizontal. Thus, with this assumption the application of the ‘‘method of images’’ and Green’s Identity to problem (2.3) yields the following integral expression[12, 14] for potential $V_c(\mathbf{x}_c)$ at an arbitrary point $\mathbf{x}_c \in E_c$, in terms of the unknown leakage current density $\sigma(\boldsymbol{\xi})$ at any point $\boldsymbol{\xi}$ of the electrode surface $\Gamma \subset E_b$:

$$(3.1) \quad V_c(\mathbf{x}_c) = \frac{1}{4\pi\gamma_b} \int \int_{\boldsymbol{\xi} \in \Gamma} k_{bc}(\mathbf{x}_c, \boldsymbol{\xi}) \sigma(\boldsymbol{\xi}) d\Gamma, \quad \forall \mathbf{x}_c \in E_c,$$

where integral kernels $k_{bc}(\mathbf{x}_c, \boldsymbol{\xi})$ are formed by infinite series of terms corresponding to the resultant images obtained when Neumann exterior problem (2.3) is transformed into a Dirichlet one[12, 14, 16]. In the case of uniform soil, the series are reduced to only two summands, since there is only one image of the original grid[4, 5, 6].

Weakly singular kernel $k_{bc}(\mathbf{x}_c, \boldsymbol{\xi})$ depends on the conductivity of the layers, and on the inverse of the distances from the point \mathbf{x}_c to the point $\boldsymbol{\xi}$ and to all the images of $\boldsymbol{\xi}$ with respect to the earth surface Γ_E and to the interfaces Γ_c between layers[12, 14]. A general form to express these integral kernels is given by:

$$(3.2) \quad k_{bc}(\mathbf{x}_c, \boldsymbol{\xi}) = \sum_{l=0}^{\infty} k_{bc}^l(\mathbf{x}_c, \boldsymbol{\xi}), \quad k_{bc}^l(\mathbf{x}_c, \boldsymbol{\xi}) = \frac{\psi^l(\kappa)}{r(\mathbf{x}_c, \boldsymbol{\xi}^l(\boldsymbol{\xi}))},$$

being ψ^l a weighting coefficient that only depends on a certain ratio κ defined in terms of the layer conductivities and $r(\mathbf{x}_c, \boldsymbol{\xi}^l(\boldsymbol{\xi}))$ the Euclidean distance between the points \mathbf{x}_c and $\boldsymbol{\xi}^l$, being $\boldsymbol{\xi}^0$ the point $\boldsymbol{\xi}$ on the electrode surface ($\boldsymbol{\xi}^0(\boldsymbol{\xi}) = \boldsymbol{\xi}$), where $\boldsymbol{\xi}^l$ ($l \neq 0$) are the images of $\boldsymbol{\xi}$ with respect to the earth surface and to the interfaces between layers[12, 14]. For example, in the particular case of a two-layer soil model ratio κ is given by $(\gamma_1 - \gamma_2)/(\gamma_1 + \gamma_2)$ and four cases must be considered depending on the layer where the points \mathbf{x}_c and $\boldsymbol{\xi}^l$ are located. In each case, several series with different locations of their images and different weighting coefficients are added. Explicit expressions of these kernels can be found in [12, 14, 16].

Now, since the expression for the potential (3.1) also holds on electrode surface Γ (where potential is known by the boundary condition $V_b(\boldsymbol{\chi}) = 1, \forall \boldsymbol{\chi} \in \Gamma$), the leakage current density σ must satisfy the following Fredholm integral equation of the first kind on Γ :

$$(3.3) \quad \iint_{\boldsymbol{\chi} \in \Gamma} w(\boldsymbol{\chi}) \left(\frac{1}{4\pi\gamma_b} \iint_{\boldsymbol{\xi} \in \Gamma} k_{bb}(\boldsymbol{\chi}, \boldsymbol{\xi}) \sigma(\boldsymbol{\xi}) d\Gamma - 1 \right) d\Gamma = 0,$$

for all members $w(\boldsymbol{\chi})$ of a suitable class of test functions defined on Γ [4, 5, 6]. It is obvious that a numerical approach based on the Boundary Element Method seems to be the best choice to solve equation (3.3).

4. BEM Numerical Formulation.

4.1. General 2D approach. The numerical resolution of the variational form (3.3) requires the discretization of the domain (the surface of the cylindrical conductors) and the leakage current density that flows from the grounded electrode. Thus, for given sets of \mathcal{N} trial functions $\{N_i(\boldsymbol{\xi})\}$ defined on Γ , and \mathcal{M} two dimensional boundary elements $\{\Gamma^\alpha\}$, the leakage current density σ and the electrode surface Γ can be discretized as follows:

$$(4.1) \quad \sigma(\boldsymbol{\xi}) = \sum_{i=1}^{\mathcal{N}} \sigma_i N_i(\boldsymbol{\xi}), \quad \Gamma = \bigcup_{\alpha=1}^{\mathcal{M}} \Gamma^\alpha,$$

Now, if we take into account that kernels (3.2) are given by series, integral expression (3.1) for potential $V_c(\mathbf{x}_c)$ can also be discretized as

$$(4.2) \quad V_c(\mathbf{x}_c) = \sum_{i=1}^{\mathcal{N}} \sigma_i V_{c,i}(\mathbf{x}_c); \quad V_{c,i}(\mathbf{x}_c) = \sum_{\alpha=1}^{\mathcal{M}} \sum_{l=0}^{l_V} V_{c,i}^{\alpha l}(\mathbf{x}_c);$$

$$(4.3) \quad V_{c,i}^{\alpha l}(\mathbf{x}_c) = \frac{1}{4\pi\gamma_b} \iint_{\boldsymbol{\xi} \in \Gamma^\alpha} k_{bc}^l(\mathbf{x}_c, \boldsymbol{\xi}) N_i(\boldsymbol{\xi}) d\Gamma^\alpha;$$

where l_V represents the number of terms that is necessary to consider until convergence is achieved.

On the other hand, for a given set of \mathcal{N} test functions $\{w_j(\boldsymbol{\chi})\}$ defined on Γ , variational form (3.3) is reduced to the following linear system:

$$(4.4) \quad \sum_{i=1}^{\mathcal{N}} R_{ji} \sigma_i = \nu_j \quad (j = 1, \dots, \mathcal{N})$$

$$R_{ji} = \sum_{\beta=1}^{\mathcal{M}} \sum_{\alpha=1}^{\mathcal{M}} \sum_{l=0}^{l_R} R_{ji}^{\beta\alpha l}, \quad \nu_j = \sum_{\beta=1}^{\mathcal{M}} \nu_j^\beta,$$

being coefficients $R_{ji}^{\beta\alpha l}$ and ν_j^β :

$$(4.5) \quad R_{ji}^{\beta\alpha l} = \frac{1}{4\pi\gamma_b} \iint_{\boldsymbol{\chi} \in \Gamma^\beta} w_j(\boldsymbol{\chi}) \iint_{\boldsymbol{\xi} \in \Gamma^\alpha} k_{bb}^l(\boldsymbol{\chi}, \boldsymbol{\xi}) N_i(\boldsymbol{\xi}) d\Gamma^\alpha d\Gamma^\beta,$$

$$(4.6) \quad \nu_j^\beta = \iint_{\boldsymbol{\chi} \in \Gamma^\beta} w_j(\boldsymbol{\chi}) d\Gamma^\beta,$$

where l_R represents the number of terms that is necessary to consider until convergence is achieved.

It is important to emphasize that the solution of linear equations (4.4) provides the values of the intensities σ_i ($i = 1, \dots, \mathcal{N}$) leaking from the nodes of the grid. With these values, it is possible to compute the potential at any point on the earth surface or even at any inner point —by means of (4.2) and (4.3)—, the leakage current density σ —by means of (4.1)—, and all the design and safety parameters of the grounding system[1, 5, 6].

Nevertheless, the statement of the above linear system requires the discretization of a 2D domain: the whole surface Γ of the grounding electrodes, which implies a large number of degrees of freedom in practical cases. Besides, its matrix is full and the computation of its coefficients requires to perform double integration on 2D domains. For all these reasons, it is necessary to introduce some additional hypotheses in order to decrease the computational cost.

4.2. Approximated 1D boundary element approach. An approximated boundary element numerical approach to the previous one presented can be derived if the real geometry of the grounding systems in practice is considered. Thus, since the ratio between the diameter and the length of the grounded conductors is very small ($\sim 10^{-3}$), the hypothesis of circumferential uniformity (i.e., the leakage current density σ is constant around the cross section of the cylindrical conductors of the grounding grid) can be assumed producing a notable fall of the computational cost[1, 5, 6]. In this way, discretizations (4.1) and (4.4) become much simpler, since the classes of test and trial functions are restricted to those with circumferential uniformity, while only the axial lines of the grounding electrodes have to be discretized[5, 6].

Now, for a given level of mesh refinement, the number of element contributions $R_{ji}^{\beta\alpha}$ and ν_j^β that we need to compute in order to state linear system (4.4), as much as the number of unknowns σ_i are significantly smaller than in the previous 2D approach, since it is required the discretization of a simpler domain: the axial lines of the grounding electrodes. Despite of this important reduction in the computation effort, extensive computing is still necessary mainly because of the circumferential integration on the perimeter of the electrodes that are involved in the integral kernels[5, 6]. However, these circumferential integrals can be performed in an approximated way if suitable simplifications in the general approach are introduced[12, 14].

The selection of different sets of trial and test functions in the numerical scheme allows to derive different formulations. Further discussion in this paper is restricted to the case of a Galerkin type approach, since the matrix of coefficients is symmetric and positive definite[5, 6]. As the 1D approximated expressions for terms $V_{c,i}^{\alpha l}$ and $R_{ji}^{\beta\alpha l}$ in (4.3) and (4.5) are formally equivalent to those obtained in the case of uniform soil models[12, 14], these terms can be computed by using the highly efficient analytical integration techniques derived by the authors to compute these coefficients for the uniform soil case[5, 6, 9, 12, 14].

The example presented in the next section corresponds to the analysis of a grounding system embedded in a two-layer soil model. Obviously, this boundary element formulation can be applied to any other case with a higher number of layers. However, CPU time may increase up to un-admissible levels, mainly due to the poor rate of convergence of the underlying series expansions, and the need to evaluate double series (in three-layer models), triple series (in four-layer models), and so on.

4.3. Total efficiency of the numerical approach. An important aspect of the numerical formulation proposed is its total computational cost. Thus, for specific discretization (\mathcal{M} elements of p nodes each, and a total number of \mathcal{N} degrees of freedom), a linear system (4.4) of order \mathcal{N} must be generated and solved.

Matrix generation process requires $O(\mathcal{M}^2 p^2 / 2)$ operations, since p^2 series of contributions of type (4.5) have to be computed for every pair of elements, and approximately half of them are discarded because of symmetry. In uniform soil models these series are formed by only two terms, while in two-layer models the series have an infinite number of them, that will be numerically added up until a tolerance is fulfilled or an upper limit of summands is achieved. Consequently, matrix generation will be much more expensive in two-layer models. In connection with the linear system solving process, it requires $O(\mathcal{N}^3 / 3)$ operations (since the matrix is symmetric but not sparse) if the resolution is carried out with a direct method.

Hence, most computing effort is devoted to matrix generation in small/medium problems, while linear system resolution prevails in medium/large ones. In these cases, the use of direct methods for the linear system resolution is out of range. Therefore iterative or semiiterative techniques will be preferable. The best results have been obtained by a diagonal preconditioned conjugate gradient algorithm with assembly of the global matrix[5].

This technique has turned out to be extremely efficient for solving large scale problems, with a very low computational cost in comparison with matrix generation. So the cost of the system resolution should never prevail.

On the other hand, once the leakage current has been obtained, the cost of computing the equivalent resistance is negligible. The additional cost of computing potential at any given point (normally at the earth surface) by means of (4.2) only requires $O(\mathcal{M}p)$ operations, since p series of contributions of type (4.3) have to be computed for every element. However, if it is necessary to compute potentials at a large number of points (i.e. to draw contours), computing time may be important.

5. Application Examples to Grounding Analysis. This boundary element approach has been integrated in a Computer Aided Design system for grounding analysis. The computer program has been developed for running in sequential mode (in conventional computers) or in parallel mode (in parallel computers). In this section two examples of earthing analysis are presented by using the geometry of grounding grids of real electrical substations. Further on, we will discuss the implementation of the numerical code and its parallelization, that is, the distribution of different tasks of the program among several processors.

5.1. Example 1: the Barberá grounding system. The first example we present is the grounding grid of the Barberá substation. This earthing grid is formed by a grid of 408 segments of cylindrical conductor of the same diameter (12.85 mm) buried to a depth of 80 cm. The grounding system has a right-angled triangle shape of 143×89 m and protects a total area of $6,600 \text{ m}^2$ (Figura 5.1). The grid has been discretized in 408 linear leakage current elements which implies 238 degrees of freedom. The Ground Potential Rise (GPR) considered in this study has been 10 kV.

In order to illustrate the capacity of the numerical approach, this grounding system has been calculated by using a uniform soil model ($\gamma = 0.016 (\Omega\text{m})^{-1}$), and a more interesting two-layer soil model (the conductivities of the upper and the lower layer are $\gamma_1 = 0.005 (\Omega\text{m})^{-1}$ and $\gamma_2 = 0.016 (\Omega\text{m})^{-1}$ respectively, and the thickness of the upper layer is 1.0 m).

Figure 5.2 shows the potential distribution on the earth surface obtained for the uniform soil case and for the two-layer soil model. The equivalent resistance and the total surge current of the earthing system computed in each case has been 0.3128Ω and $I=31.97 \text{ kA}$ (for the uniform soil model), and 0.3704Ω and $I=26.99 \text{ kA}$ (for the two-layer soil model).

5.2. Example 2: the Balaidos grounding system. Next we present the analysis of a substation grounding considering 3 different soil models by using the presented BEM approach. The earthing grid is formed by a mesh of 107 cylindrical conductors (diameter: 11.28 mm) buried to a depth of 80 cm, supplemented with 67 vertical rods (each one has a length of 1.5 m and a diameter of 14.0 mm) (Figure 5.3). The Ground Potential Rise considered has been 10 kV, and the numerical model used in the analysis has been a Galerkin formulation with a discretization in 241 elements.

The different soil models considered are the following: Model A is a uniform soil model with a conductivity of $0.020 (\Omega\text{m})^{-1}$; Model B is a 2-layered soil model formed by an upper layer of $0.0025 (\Omega\text{m})^{-1}$ and a thickness of 70 cm and a lower layer with a conductivity of $0.020 (\Omega\text{m})^{-1}$ (consequently, all electrodes of the grounding grid are buried in the lower layer); and Model C is also a 2-layered soil model formed by an upper layer of $0.0025 (\Omega\text{m})^{-1}$ and a thickness of 1 m and a lower layer with a conductivity of $0.020 (\Omega\text{m})^{-1}$ (consequently, most electrodes of the grounding grid are buried in the upper layer while part of the vertical rods are in the lower layer).

Figure 5.4 shows the potential distribution ($\times 10 \text{ kV}$) on the earth surface obtained by using the soil models A, B and C. Table 5.1 shows the Equivalent Resistance of the grounding

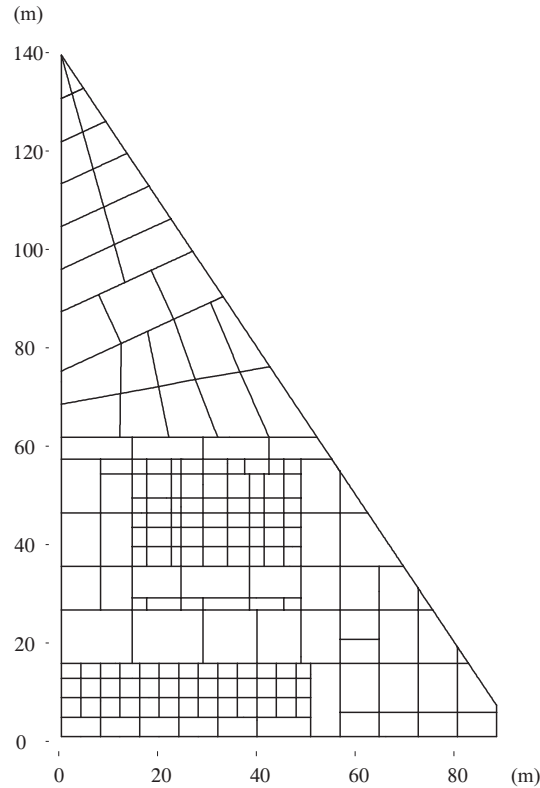


FIG. 5.1. Barberá grounding system: Plan of the grounding grid.

TABLE 5.1

Balaidos Grounding System: Equivalent Resistance of the grounding grid and Total Current leaked to the ground for the different soil models

Soil Model	Equivalent Resistance (Ω)	Total Current (kA)
A	0.3366	29.71
B	0.3522	28.39
C	0.4860	20.58

system and the Total Current that flows to the ground for each case. As it is shown, results noticeably vary when different soil models are used, and in consequence, the grounding design parameters (Equivalent Resistance, Touch-Voltage, Step-Voltage and Mesh-Voltage) significantly change.

As we can see in these examples, results obtained by using a multiple-layer soil model can be noticeably different from those obtained by using a single layer (or uniform) soil model. Therefore, it could be advisable to use multi-layer soil formulations to analyze grounding systems as a general rule, in spite of the increase of the computational effort. In fact, the use of this kind of advanced models should be mandatory in cases where the conductivity of the soil changes markedly with depth.

However, while single-layer models run in real time in conventional computers for the analysis of medium/big size grounding grids, multiple-layer models require in general an out of order computing time. In the next section, the main aspects of the parallelization of the multi-layer boundary element numerical approach for grounding analysis are discussed.

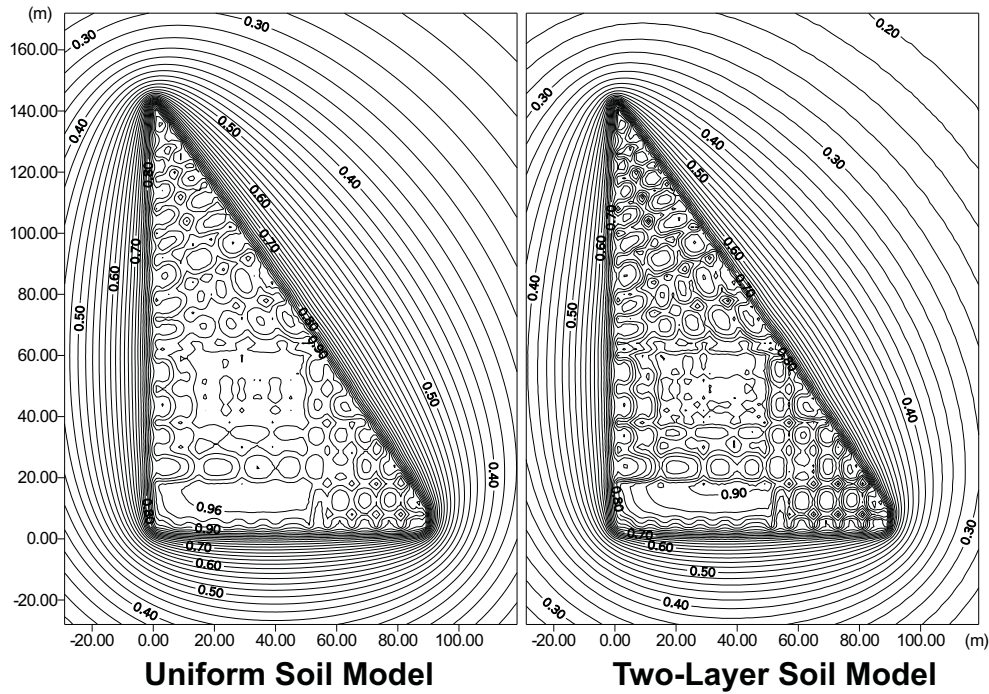


FIG. 5.2. Barberá grounding system: Potential distribution on earth surface ($\times 10$ kV) obtained by using uniform and two-layer soil models.

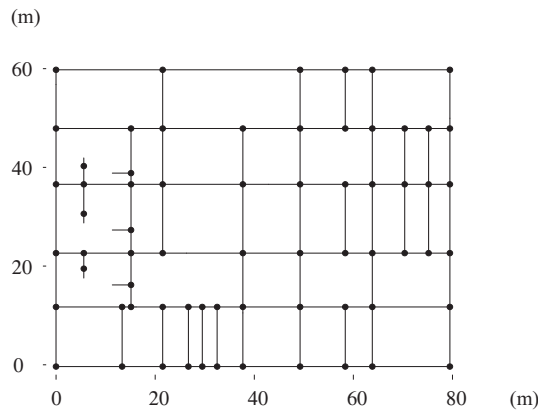


FIG. 5.3. Balaidos Grounding System: Plan of the grounding grid (vertical rods are marked with black points).

6. Parallelization of the Proposed BEM Approach.

6.1. Parallel computer and parallelization mode. The numerical approach has been implemented on a CAD system, which has been compiled and run onto an *Origin 2000 Silicon Graphics* computer at the *European Center for Parallelism of Barcelona* (CEPBA). The compilation process of the code has been made in sequential and parallel modes, and the executions have been run for the uniform and the two-layer models [15].

As we have exposed in previous sections, the most critical time-consuming process of this numerical formulation based on the Boundary Element Method is matrix generation,

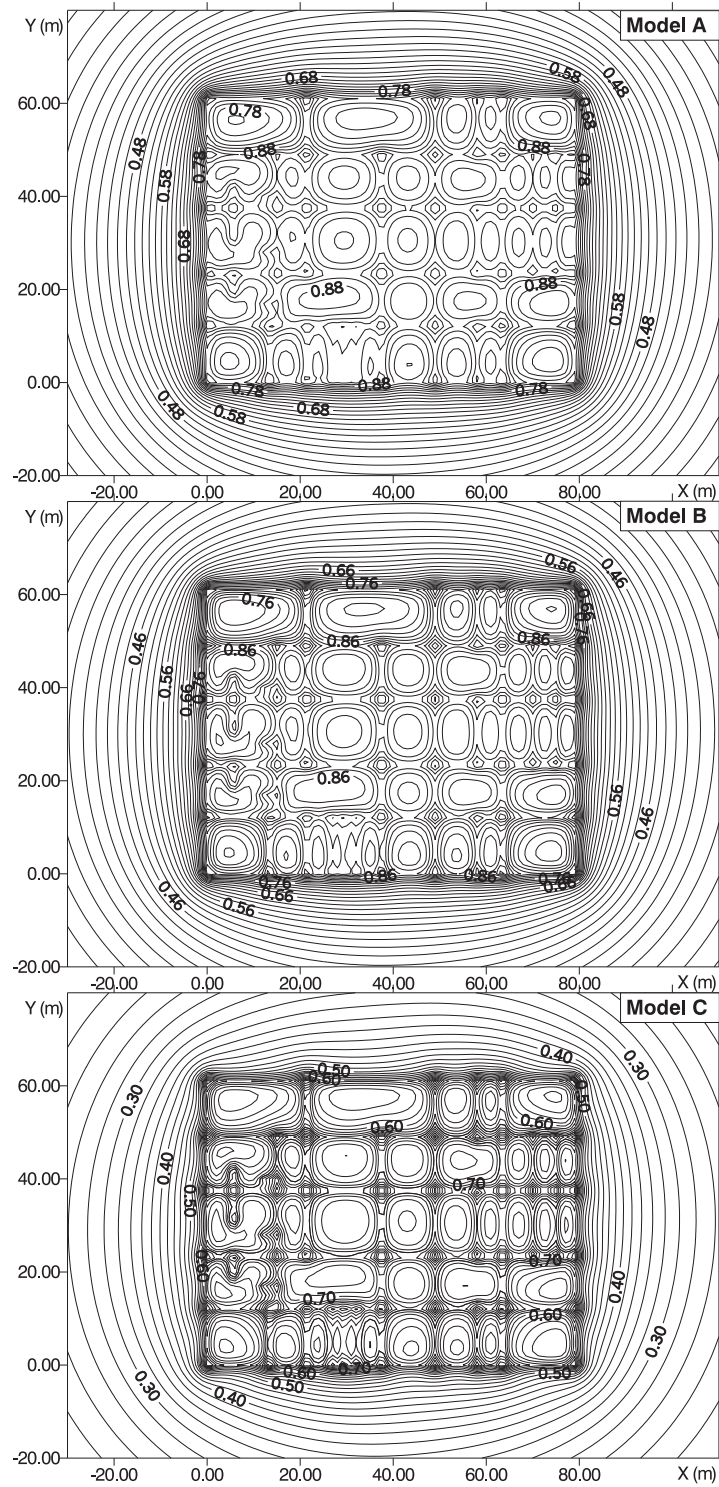


FIG. 5.4. Balaidos Grounding System: Potential distribution ($\times 10kV$) on the earth surface for different soil models.

TABLE 6.1

Barberá Grounding System: CPU time in sequential execution for each process of the program in the two-layer grounding analysis obtained with the O2000 computer

Process	CPU time(s)
Data Input	0.737
Data Preprocessing	0.045
Matrix Generation	1723.207
Linear System Solving	0.211
Results Storage	0.015

followed by computation of potential at a large number of points once the leakage current density has been obtained. Since both processes accept massive parallelization, computing time could be reduced under acceptable levels, even for cases of extremely large models, if the number of available processors is high enough, in spite of the efficiency losses due to the data transfer overhead and the system administration workload. Table 6.1 summarizes the CPU time required in each process of the implementation of the numerical approach for the Barberá grounding system in the two-layer soil model case. It is evident that the matrix construction is the most expensive part of it.

The O2000 used in our work is a high-performance computer with 64 MIPS R10000 processors at 250 MHz. It has a peak performance of 32 GFlops. Internally, the O2000 is organized in clusters of 2 processors sharing a main memory of 256 Mbyte. Each processor has 4 Mbyte of cache memory. The clusters are connected by an hypercube network. Each processor can access all the distributed main memory through the network. Then, the O2000 can be programmed as an 8 Gbyte shared memory machine. The input/output devices have a capability of 1.2 Gbytes/s.

The parallelization mode selected for this problem has been the use of compiler directives, following the present OpenMP standard. This selection is justified because: *a)* a shared memory computer is available for running the program (necessary condition for using compiler parallelization directives), *b)* the use of compiler directives grants clearness to a parallel code that may be handled in the future, *c)* the OpenMP syntax assures the portability of the parallel code to any shared memory computer, and *d)* as we will see below, the loop to be run in parallel is transformable into an adequate form so that directives are efficient. A parallelization scheme that mixes threads and message passing in boundary element applications can be found in reference [17].

6.2. Parallelization of the code. In the sequential program, the matrix generation process is performed by means of a double loop that couples every element with all the other $\mathcal{M}(\mathcal{M} + 1)/2$ cycles. Into each cycle, the elemental matrix corresponding to a pair of elements is calculated and immediately assembled into the system matrix. If we try to parallelize this double loop, we find that the assembly of the elemental matrices causes a dependency between the actions of the threads or processes. This drawback can be avoided by taking the assembly process out of that loop, which implies first the computation and the storage of all the elemental matrices and, after this step, the assembly in a sequential mode. This scheme requires approximately twice the memory space than the original one, but in any case this memory space is not very large. If $\mathcal{N} = O(10^3)$ then the matrix size is $O(10^6)$ bytes.

Then, the target code is the nested DO loops that compute the elemental matrices, and we can parallelize the outer loop or the inner one. This is the first choice studied. Figure 6.1 shows the evolution of the speed-up factor obtained with different number of processors for both types of parallelization in the analysis of the Barberá grounding system with a two-layer soil model (the speed-up factor has been referenced to the sequential CPU time).

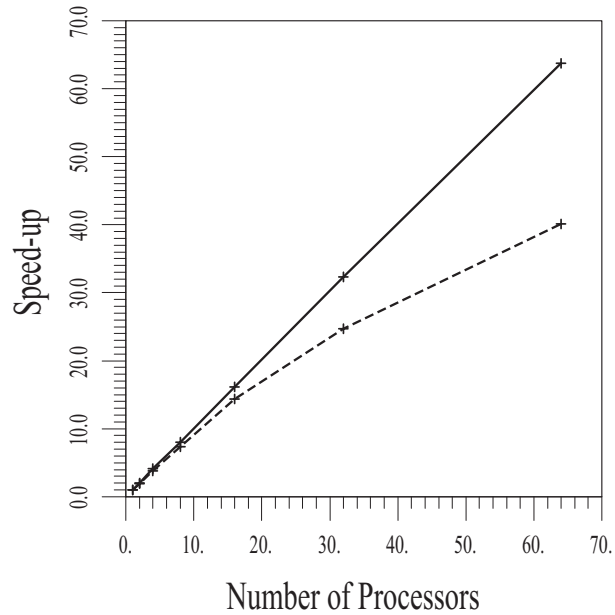


FIG. 6.1. *Barberá grounding system: Comparison between the speed-up obtained with the parallelization of the outer loop (in continuous line) and the inner loop (in discontinuous line).*

These results have been obtained with the schedule option “Dynamic,1” (we will discuss the schedule options below), and they correspond to the minimum of 4 CPU time measures made for the same option (the variance of the four ones is very small, anyway), in order to approximate better the strict value. In some cases, we have obtained speed-ups bigger than the number of processors due to small errors in the measurement of CPU time by the processors, and to the additional optimization of the code that the parallel compiler introduces.

Results are better when the outer loop is parallelized because the granularity is bigger in that way, and so the cost of managing the parallel execution is minor: since the numerical approach leads to a symmetric formulation, the coupling of every element of the grid with each one of the others can be represented by a triangle of \mathcal{M} columns, of which the first one has \mathcal{M} rows and the last one has 1 row. Hence, if the outer loop is parallelized, the columns of the triangle, that is, the cycles of the outer loop, are distributed among the processors. Whereas, if the inner loop is parallelized, the rows of one column are distributed among the processors. In this case, when computations on that column are finished the program moves sequentially to the next one, where another distribution of its rows among the processors is performed. This effect of granularity is, of course, more sensible when the number of processors grows, as figure 6.1 shows.

As the parallelization of the outer loop is preferable, and the cycles that it is necessary to distribute among the processors have very different sizes, the way to do this distribution becomes a decisive question. Table 6.2 summarizes the speed-up factors (referenced to the sequential CPU time) obtained for the outer-loop parallelization with different number of processors by using different “schedule” OpenMP options. Since the size of the cycles is linearly decreasing, “static” schedules with a high “chunk” (i.e., the number of cycles in a task) are the less profitable ones. When no chunk value is specified, all the columns are uniformly distributed in the beginning. “Dynamic” schedules improve this behavior because as each processor finishes a task, it dynamically takes the next one. Best results are obtained for a dynamic schedule with a chunk parameter of 1 column. This is the most lively

TABLE 6.2

Barberá Grounding System: Speed-up factors for different schedules and number of processors in the outer loop parallelization for the two-layer soil model

Schedule ()	Number of Processors			
	1	2	4	8
Static	1.01	1.32	2.32	4.38
Static,64	1.02	1.76	1.86	3.55
Static,16	1.02	1.94	3.59	6.23
Static, 4	1.01	2.01	3.96	7.36
Static, 1	1.02	2.03	4.03	7.99
Dynamic,64	1.02	2.02	3.56	3.55
Dynamic,16	1.02	2.02	4.08	7.87
Dynamic, 4	1.01	2.04	3.99	7.90
Dynamic, 1	1.02	2.03	4.09	8.05
Guided,64	1.02	1.97	3.56	3.56
Guided,16	1.02	1.99	3.96	8.03
Guided, 4	1.02	2.01	4.11	7.93
Guided, 1	1.02	2.07	3.95	8.38

TABLE 6.3

Balaidos Grounding System: CPU Time (in s) by using 1,2,4 and 8 processors for different soil models (in brackets, the speed-up factors).

Soil Model	Number of Processors			
	1	2	4	8
A	2.44 (1)	—	—	—
B	81.26 (1)	40.85 (1.98)	20.41 (3.98)	10.09 (8.05)
C	443.28 (1)	218.10 (2.03)	111.38 (3.98)	53.53 (8.28)

scheme, since there are never waiting processors, although it requires the biggest amount of parallelization management. “Guided” schedules distribute initially all the columns among all the processors into pieces with size exponentially varying. In this case, results are very similar to those obtained with the “dynamic” ones. In general, for any schedule, we obtained worse results when the chunk parameter and the number of processors are high because then some processors do not get any work.

Therefore, as we can see, speed-up factors obtained for the outer parallelization are very close to the number of processors for good schedules, that is, “dynamic” or “guided” with low chunk parameters. This fact reveals that the parallelization of this loop is very profitable: in the example, the Barberá grounding analysis in a two layer soil model, 99.9% of the work of the whole processing program is dealt with only 408 tasks.

The conclusions of this analysis with the Barberá grounding system have been applied to the second example. Table 6.3 shows the CPU times and speed-up factors obtained in the matrix generation process of the grounding analysis for the three soil models considered by using different number of processors. As we can see, the results agree with those obtained for the Barberá case. Now, as in the previous example, in some cases speed-up factors bigger than the number of processors are obtained due to small errors in the measurement of CPU time by the processors and to the additional optimization of the code that the parallel compiler introduces. Finally, it is important to remark that the increase in the CPU time in the model C is due to the type of soil model considered. In this case, a part of the vertical rods are in the upper layer and other part in the lower, and consequently integral kernels combining electrodes in different layers have to be used [12]. These integral kernels

are different from those used in the model B (all the electrodes are in the same layer) and they involve series with a lower rate of convergence.

7. Conclusions. Accurate analysis of grounding systems of electrical installations requires the use of multilayer soil models when the soil is not essentially uniform in the surroundings of the earthing grid. At present, while uniform soil models run in real-time in conventional computers, the use of models with a small number of soil layers breaks off the design process due to the important computing time required in practical cases.

In last years, the authors have developed a BEM numerical approach for the analysis of grounding systems embedded in stratified soils that has been implemented in a high performance parallel computer. This numerical approach accepts massive parallelization since most of the computing time is required in the computation of the elemental matrices corresponding to the contribution of each electrode of the grounding grid. Results obtained with different parallelization options prove that the proposed multi-layer Boundary Element formulation can be a real-time design tool, as high-performance parallel computing becomes a widespread available resource in engineering.

Acknowledgements. This work has been partially supported by the *Ministerio de Ciencia y Tecnología* of the Spanish Government (grants # DPI2001-0556 and # 1FD97-0108), cofinanced with European Union FEDER funds, by the power company *Unión Fenosa Ingeniería, UFISA*, and by research fellowships of the *European Center for Parallelism of Barcelona, CEPBA* and the *Universidad de A Coruña*.

REFERENCES

- [1] IEEE Std.80, *IEEE Guide for safety in AC substation grounding*, New York, 2000.
- [2] Sverak J.G., *Progress in Step and Touch Voltage Equations of ANSI/IEEE Std.80*, IEEE Trans. Power Delivery, **13**, 762–767, 1999.
- [3] Garret D.L., Pruitt J.G., *Problems Encountered with the APM of Analyzing Grounding Systems*, IEEE Trans. P.A.S., **104**, 4006–4023, 1985.
- [4] Navarrina F., Colominas I., Casteleiro M., *Analytical Integration Techniques for Earthing Grid Computation by BEM*, Num. Met. in Eng. and Appl. Sci., 1197–1206, CIMNE, Barcelona, 1992.
- [5] Colominas I., Navarrina F., Casteleiro M., *A boundary element numerical approach for grounding grid computation*, Comput. Methods Appl. Mech. Engrg., **174**, 73-90, 1999.
- [6] Navarrina F., Colominas I., Casteleiro M., *Why Do Computer Methods For Grounding Analysis Produce Anomalous Results?*, IEEE Trans. on Power Delivery, **In press**, 2002.
- [7] Casteleiro M., Hernández L.A., Colominas I. and Navarrina F., *Memory and User guide of system TOTBEM for CAD of grounding grids in electrical installations*, Civil Engrg. Sch., Universidad de La Coruña, 1994.
- [8] Silvester P.P. and Ferrari R.L., *Finite Elements for Electrical Engineers*, Cambridge University Press, Cambridge, U.K., 1996.
- [9] Colominas I., *A CAD System for Grounding Grids in Electrical Installations: A Numerical Approach Based on the Boundary Element Integral Method*, Ph.D. Thesis, Universidad de A Coruña, Spain, 1995.
- [10] Durand E., *Électrostatique*, Masson, Paris, France, 1966.
- [11] Kellog O.D., *Foundations of Potential Theory*, Springer-Verlag, Berlin, Germany, 1967.
- [12] Colominas I., Navarrina F., Casteleiro M., *A Numerical Formulation for Grounding Analysis in Stratified Soils*, IEEE Trans. on Power Delivery, **17**, 587–595, 2002.
- [13] Colominas I., Navarrina F., Casteleiro M., *A Boundary Element Formulation for the Substation Grounding Design*, Advances in Engineering Software, **30**, 693–700, 1999.
- [14] Colominas I., Gómez J., Navarrina F., Casteleiro M., *Computer Analysis of Earthing Systems in Horizontally or Vertically Layered Soils*, Electric Power Systems Research, **59**, 149–156, 2001.
- [15] Colominas I., Navarrina F., Mosqueira G., Eiroa J.M., Casteleiro M., *Numerical modelling for grounding grids in high-performance parallel computers*, Intern. Series on Adv. in Boundary Elements: Boundary Elements XXII, Comp. Mech. Pub., Southampton, UK, 2000.
- [16] Tagg G.F., *Earth Resistances*, Pitman Pub. Co., New York, 1964.
- [17] Cela J.M., Julia A., *High performance computing on boundary element simulations*, Intern. Series on Adv. in Boundary Elements: Boundary Elements XXII, Comp. Mech. Pub., Southampton, UK, 2000.